


1A P.T. 2X6 STUDS @ 16 O.C. WITH R-19 THERMAL
BATT INSULATION AND 5/8" TYPE "X" GWB
(INTERIOR SIDE ONLY), FIRE TAPED AND
BEDDED, PLUMB AND SQUARE TO UNDERSIDE
OF ROOF DECK ON INTERIOR SIDE, 1/2"
EXTERIOR-GRADE PLYWOOD SHEATHING ON
EXTERIOR SIDE, WEATHER BARRIER, AND
CEMENT PLASTER.



- A. PROVIDE ACCESSIBLE THRESHOLDS. RAISED THRESHOLDS AND FLOOR LEVEL CHANGES AT ACCESSIBLE DOORWAYS TO BE BEVELED WITH A SLOPE NO GREATER THAN 1:12.
- B. ALL DIMENSIONS ARE TO FINISHED FACE UNLESS SHOWN OR NOTED OTHERWISE.
- C. ALL DOORS SHALL BE 32" MINIMUM CLEAR OPENING WHEN OPENED TO 90 DEGREE POSITION UNLESS OTHERWISE NOTED.
- D. SEE SHEET A6002 FOR DOOR AND WINDOW SCHEDULES.
- E. DO NOT SCALE DRAWINGS.

1. STRUCTURAL COLUMN. SEE STRUCTURAL.
2. CONCRETE RIBBON SLAB OVER VAPOR BARRIER OVER COMPACTED FILL. SLAB LEAVE-OUT AREA TO BE PROVIDED TO FUTURE TENANT WITH CLEAN COMPACTED FILL 4" BELOW F.F. SEE STRUCTURAL DRAWINGS.
3. INSTALL NEW DOORS AS INDICATED. SEE SHEET A6002 FOR DOOR AND HARDWARE TYPE.
4. ELECTRICAL PANEL LOCATIONS. MAINTAIN MINIMUM CLEARANCE AS REQUIRED BY CODE.
5. ROOF ACCESS LADDER. SEE DETAILS ON A5003.
6. OUTLINE OF CANOPY ABOVE. SEE ROOF PLAN AND EXTERIOR ELEVATIONS.
7. CONCRETE SILL BELOW STOREFRONT, SEE STRUCTURAL DRAWINGS.
8. 4"x4" DOWNSPOUT. CONNECT TO UNDERGROUND STORM DRAINAGE.

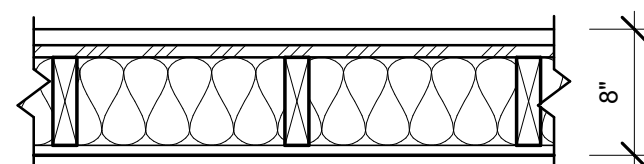

Scale: $1/4" = 1'-0"$

WHITSETT
6405 BURLINGTON RD
WHITSETT, NC 27377

DIMENSIONED FLOOR PLAN

PROJECT MANAGER	DESIGNER
AK	DB

2020379.16

A1101